

March 2021

1805 Series Relief Valves



WARNING

Failure to follow these instructions or to properly install and maintain this equipment could result in an explosion and/or fire causing property damage and personal injury or death.

Fisher™ relief valves must be installed, operated and maintained in accordance with federal, state and local codes, rules and regulations, and Emerson Process Management Regulator Technologies, Inc. instructions.

If a leak develops or if the outlet continually vents gas, service to the unit may be required.

Failure to correct trouble could result in a hazardous condition. Only a qualified person must install or service the unit.

Call a gas service person to service the unit. Only a qualified person must install or service the 1805 Series Relief Valves.

Introduction

Scope of the Manual

This Instruction Manual provides installation, adjustment, maintenance and parts ordering information for 1805 Series relief valves.



P1026

Figure 1. 1805 Series Relief Valve

Description

The 1805 Series relief valves are primarily designed for use in farm tap applications where a safety relief valve is needed between the first and second stage regulators. The 1805 Series is suitable for service on natural gas, air, propane or any operating medium that is not corrosive to the internal parts. Relief pressure ranges from 5 to 125 psi / 0.34 to 8.6 bar. Maximum pressure, including buildup, is 150 psi / 10.3 bar.

1805 Series

Specifications

The Specifications section lists the specifications for the 1805 Series relief valve. The following information is stamped on the relief valve at the factory: type number, date of manufacture, spring range, maximum inlet pressure and maximum allowable inlet pressure.

Available Constructions

Type 1805-2: Cast iron spring case, closing cap with 1/4 NPT vent placed over the adjusting screw. Available in 3/4 and 1 NPT body sizes.

Type 1805-3: Cast iron spring case, closing cap with 1/4 NPT vent placed over the adjusting screw. Available in 1-1/2 and 2 NPT body sizes.

Type 1805-4: Cast iron spring case. Available in 3/4 and 1 NPT body sizes.

Type 1805-5: Cast iron spring case. Available in 1-1/2 and 2 NPT body sizes.

Type 1805-7: Cast iron spring case, closing cap with 1/4 NPT vent placed over the adjusting screw, screen in outlet. Available in 3/4 and 1 NPT body sizes.

Body Style

Globe body

Body Sizes and End Connection Style

3/4, 1, 1-1/2 or 2 NPT

Maximum Inlet Pressure⁽¹⁾

150 psig / 10.3 bar including buildup

Relief Valve Set Pressure Ranges

See Table 1

Flow and IEC Sizing Coefficients

See Table 2

Temperature Capabilities⁽¹⁾

-20 to 150°F / -29 to 66°C

Approximate Shipping Weights

3/4 to 1 NPT bodies: 5 lbs / 2 kg

1-1/2 to 2 NPT bodies: 13 lbs / 6 kg

1. The pressure/temperature limits in this Instruction Manual or any applicable standard limitation should not be exceeded.

Table 1. Relief Set Pressure Ranges

BODY SIZE	RELIEF PRESSURE RANGE		SPRING PART NUMBER	SPRING COLOR CODE	SPRING FREE LENGTH		SPRING WIRE DIAMETER	
	psig	bar			In.	mm	In.	mm
3/4 or 1 NPT	5 to 35	0.34 to 2.4	1B986027212	Green	2.25	57.2	0.12	3.05
	10 to 60	0.69 to 4.1	1B788327022	Silver	2.13	54.1	0.14	3.56
	20 to 125	1.4 to 8.6	1B788427022	Blue	1.94	49.3	0.18	4.57
1-1/2 or 2 NPT	5 to 20	0.34 to 1.4	1D892327022	Red	2.94	74.7	0.17	4.32
	10 to 50	0.69 to 3.5	1D665927022	Blue	2.50	63.5	0.22	5.59
	35 to 125	2.4 to 8.6	1E543627142	Yellow	2.31	58.7	0.28	7.11

Table 2. Flow and IEC Sizing Coefficients

BODY SIZE	C _i	K _m	IEC SIZING COEFFICIENTS		
			X _T	F _D	F _L
3/4 to 1 NPT	35	0.79	0.73	0.39	0.89
1-1/2 to 2 NPT			0.94	0.44	

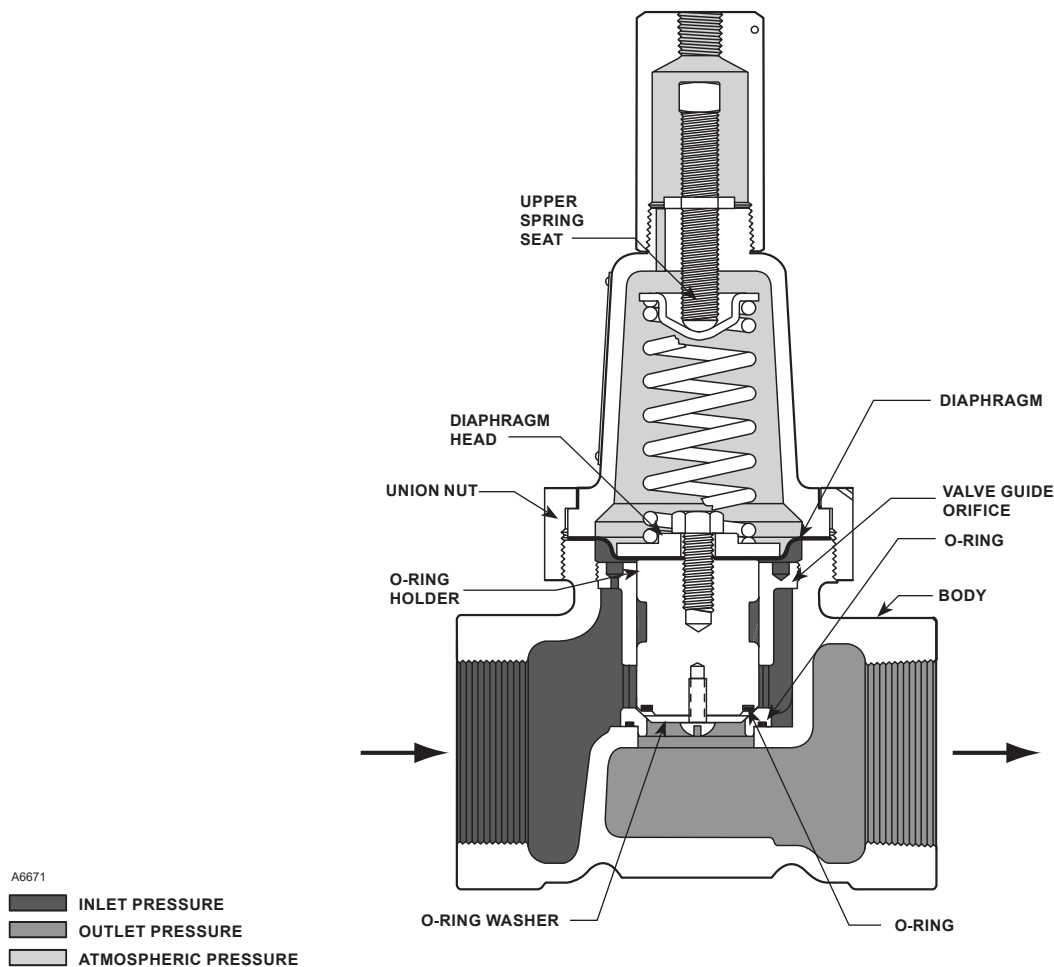


Figure 2. 1805 Series Operational Schematic

Principle of Operation

See Figure 2. Relief valves respond to changes in upstream pressure. If upstream pressure increases and exceeds the relief valve setting, the valve will open and allow gas to vent to the atmosphere. When upstream pressure returns to normal level (below the setting of the relief valve), the relief valve automatically closes and normal system operation resumes.

In the 1805 Series relief valves, the upstream pressure registers underneath the diaphragm. Gas reaches the diaphragm through the space between the O-ring holder and the valve guide orifice in 3/4 and 1 NPT bodies or through registration holes in the valve guide

orifice in 1-1/2 and 2 NPT bodies. When the upstream pressure increases beyond the spring setting, the force on the diaphragm overcomes spring compression. The O-ring holder moves upward, carrying the O-ring away from the valve seat. This opens the flow line, allows gas to flow to the atmosphere and relieves the overpressure condition. When upstream pressure registered on the diaphragm decreases to a level below that of the spring setting of the relief valve, the spring force pushes the diaphragm plate and O-ring holder toward the valve seat. Contact between O-ring and valve seat prevents further flow to atmosphere.

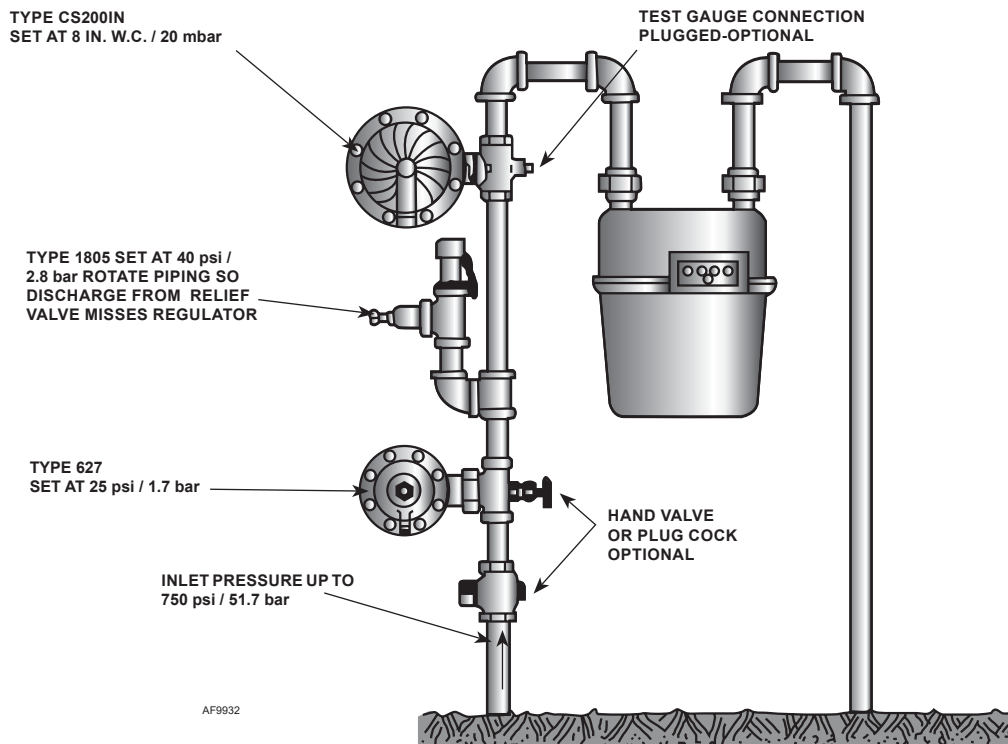


Figure 3. Typical Farm Tap Installation

Installation

After unpacking, check the relief valve for shipping damage. Remove pipe scale and other foreign material from the connecting pipeline. Coat the male pipe threads with a suitable pipe compound. The unit can be installed in any position as long as the flow is in the direction indicated by the arrow cast on the body.

Protect the outlet and vents from entrance of rain, snow or other foreign material that may plug them.

Outdoor installations should include a rain cap over the vents and outlet if they point upward. Periodically check the openings to ensure that they are not plugged.

Protect the relief valve against damage from vehicles or other external sources.

Vents



WARNING

Venting gas may accumulate and be an explosion hazard under enclosed conditions such as in pit or underground installations. Install remote vent lines to carry gas to a safe area.

If remote vent lines are necessary, use the Type 1805-2, -3 or -7 which have 1/4 NPT vent connections in the closing cap. Remove the screen if one is present in the outlet, and install remote vent lines in the outlet and closing cap openings. Remote vent lines must have the largest practical diameter as possible. The vent lines should be as short as possible with a minimum number of bends or elbows.

Overpressure

Relief pressure ratings are from 5 to 125 psi / 0.34 to 8.6 bar. The maximum inlet pressure, including buildup, is 150 psi / 10.3 bar. System operation within these limitations does not eliminate the possibility of damage from external sources or from debris in the gas line. The relief valve should be inspected for damage regularly and after any overpressure condition.

Startup

Key numbers are shown in Figure 4. With proper installation completed and system equipment properly adjusted, close any vent valves and slowly open the upstream shut-off valve while using pressure gauges to monitor pressure.

If set pressure adjustment is necessary, monitor the inlet pressure with a gauge during the adjustment procedure.

Adjustment

The range of allowable pressure settings is stamped on the spring case (Types 1805-2, -4 and -7) or on the nameplate (Types 1805-3 and -5). If a pressure setting beyond the indicated range is required, substitute the appropriate spring. Be sure to label the relief valve to indicate the new pressure range. Always use a pressure gauge to monitor pressure when making adjustments.

1. On Types 1805-2, -3 and -7 remove the closing cap (key 17).
2. Loosen hex nut (key 15).
3. To increase the relief setting, turn the adjusting screw (key 14) clockwise. To decrease the relief setting, turn the adjusting screw counterclockwise.
4. Tighten the hex nut.

Shutdown

Close the upstream shut-off valve and release all pressure from the relief valve.

Maintenance



WARNING

To avoid personal injury and equipment damage, isolate the relief valve from all pressure. Cautiously release pressure from the relief valve before attempting disassembly.

Due to normal wear that may occur in relief valves, the O-rings and diaphragm must be inspected periodically and replaced as necessary. The frequency of inspection and replacement depends upon the severity of service conditions or the requirements of state and federal laws. Instructions are given below for disassembly of the relief valve and replacement of the O-rings and diaphragm. The 1805 Series relief valves do not have to be removed from the pipeline to inspect internal parts. Refer to Figure 4 while servicing the relief valves.


Disassembly/Assembly

1. To ease spring compression, remove the closing cap (key 17, Types 1805-2, -3 and -7), loosen the hex nut (key 15) and turn the adjusting screw (key 14) counterclockwise.
2. Unscrew the union nut (key 16) and remove it with the spring case (key 13), spring (key 11) and upper spring seat (key 12).
3. Pull the O-ring holder (key 4) out of the valve guide orifice (key 2).
4. Remove the diaphragm cap screw (key 10) from the O-ring holder. Take off the diaphragm plate (key 9) and inspect the diaphragm (key 8).
5. Take the machine screw (key 7) out of the opposite end of O-ring holder, remove the O-ring washer (key 6) and inspect the O-ring (key 5).
6. Remove the valve guide orifice (key 2) from the body and check the Tetraseal® O-ring (key 3).
7. Reassemble the relief valve in reverse order of the above steps. To ensure proper slack in the diaphragm, tighten the union nut finger-tight only. Turn the adjusting screw clockwise to apply some spring force to the diaphragm. Complete the tightening of the union nut.

Parts Ordering

When corresponding with your local Sales Office or the factory concerning these relief valves, include the type number and all other pertinent information stamped on the spring case, closing cap or on the nameplate. Specify the eleven-character part number when ordering new parts from the following parts list.

When ordering replacement parts, reference the key number of each needed part as found in the following parts list. Separate kit containing all recommended spare parts is available.

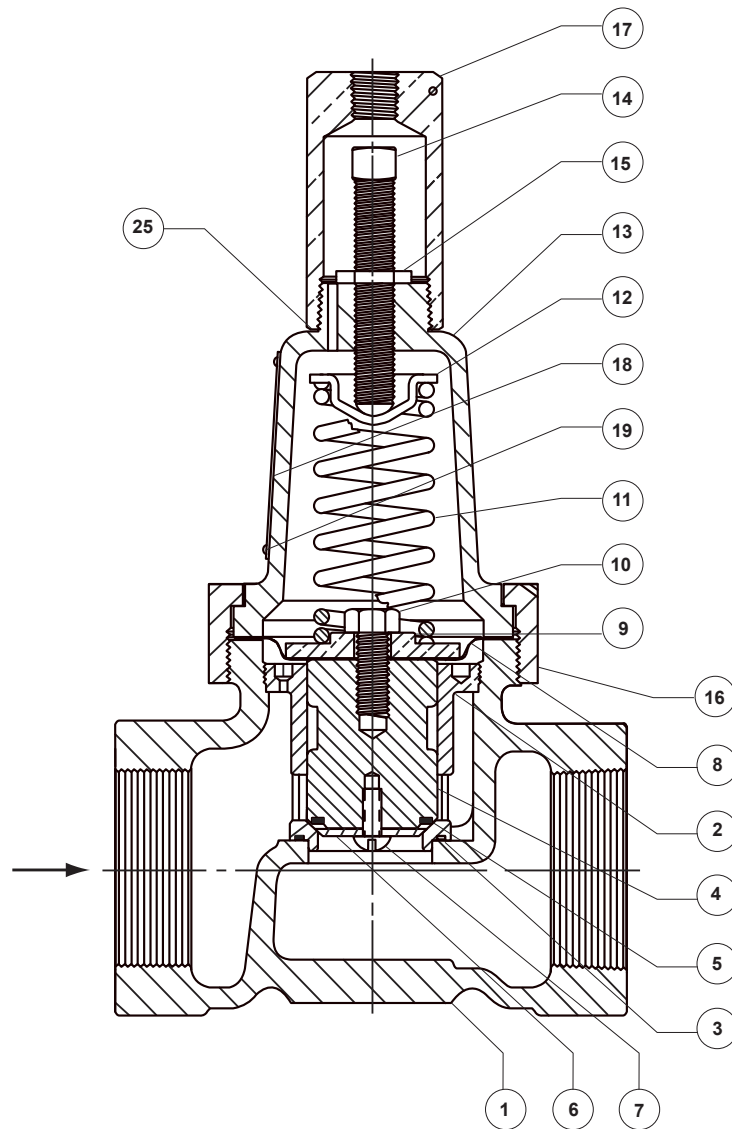

BE9481

Figure 4. Type 1805-3 Relief Valve Assembly (Also typical of Type 1805 Relief Valves)

Parts List

Key	Description	Part Number	Key	Description	Part Number
	Parts kit (included are keys 3, 5 and 8) 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	R1805X00012 R1805X00022	10	Cap Screw, Zinc-plated steel 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1B290524052 1E760324052
1	Valve Body Types 1805-2 and -4 3/4 NPT Cast iron Ductile iron (NACE) 1 NPT Cast iron Ductile iron (NACE) Types 1805-3 and -5 1-1/2 NPT Cast iron 2 NPT Cast iron Type 1805-7 3/4 NPT Cast iron 1 NPT Cast iron	1E621119012 1F192019062 1E621219012 1F192119062 1E824019012 1E824319012 1H242519012 1H242619012	11	Spring, Zinc-plated steel 3/4 and 1 NPT body sizes 5 to 35 psig / 0.34 to 2.4 bar 10 to 60 psig / 0.69 to 4.1 bar 20 to 125 psig / 1.4 to 8.6 bar 1-1/2 and 2 NPT body sizes 5 to 20 psig / 0.34 to 1.4 bar 10 to 50 psig / 0.69 to 3.5 bar 35 to 125 psig / 2.4 to 8.6 bar	1B986027212 1B788327022 1B788427022 1D892327022 1D665927022 1E543627142
2	Valve Guide Orifice, Aluminum 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1K314709012 1N939909012	12	Upper Spring Seat, Steel 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1B798525062 1D667125072
3*	Tetraseal®/O-ring, Nitrile (NBR) 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1K314806992 1N940306562	13	Spring Case, Cast Iron 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	2E770819012 2E824919042
4	O-ring Holder, Aluminum 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1E621609092 1E824609092	14	Adjusting Screw, Brass 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1E770914012 1E543214012
5*	O-ring, Nitrile (NBR) 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1D288806992 1C5622X0022	15	Hex Nut, Zinc-plated steel 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1A946324122 1D667728982
6	O-ring Washer Stainless steel 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1D335935072 1E824235072	16	Union Nut, Ductile iron 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1E471119062 1E766619062
7	Machine Screw, Steel 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	16A0429X012 1B420428982	17	Closing Cap, Brass Types 1805-2 and -7 Type 1805-3	1E770614012 1E823914012
8*	Diaphragm, Nitrile (NBR) 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1E621702052 1E824102052	19	Drive Screw, Steel (4 required) 1-1/2 and 2 NPT body sizes	1E501728982
9	Diaphragm Plate, Brass 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1E621814012 1E824714012	20	Screen, Stainless steel (not shown) Type 1805-7	1E564843122
			21	Snap Ring, 302 Stainless steel (not shown) Type 1805-7	1E564937022
			22	NACE Tag, 18-8 Stainless steel (not shown)	19A6034X012
			23	Tag Wire, 304 Stainless steel (not shown)	1U7581X0022
			24	Pipe Plug, Alloy-plated steel	1C333528992
			25	O-ring 3/4 and 1 NPT body sizes 1-1/2 and 2 NPT body sizes	1F463606992 T14380T0012

*Recommended spare part.

Tetraseal® is a mark owned by of Goshen Rubber Company.

1805 Series

 Webadmin.Regulators@emerson.com

 Fisher.com

 Facebook.com/EmersonAutomationSolutions

 LinkedIn.com/company/emerson-automation-solutions

 Twitter.com/emr_automation

Emerson Automation Solutions

Americas

McKinney, Texas 75070 USA
T +1 800 558 5853
+1 972 548 3574

Europe

Bologna 40013, Italy
T +39 051 419 0611

Asia Pacific

Singapore 128461, Singapore
T +65 6777 8211

Middle East and Africa

Dubai, United Arab Emirates
T +971 4 811 8100

D100345X012 © 1975, 2021 Emerson Process Management Regulator Technologies, Inc. All rights reserved. 03/21.

The Emerson logo is a trademark and service mark of Emerson Electric Co. All other marks are the property of their prospective owners.

Fisher™ is a mark owned by Fisher Controls International LLC, a business of Emerson Automation Solutions.

The contents of this publication are presented for informational purposes only, and while every effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which are available upon request. We reserve the right to modify or improve the designs or specifications of such products at any time without notice.

Emerson Process Management Regulator Technologies, Inc. does not assume responsibility for the selection, use or maintenance of any product. Responsibility for proper selection, use and maintenance of any Emerson Process Management Regulator Technologies, Inc. product remains solely with the purchaser.

